


EN 16798-3 Update RLT Herstellerverband




Distance outdoor air / exhaust air for AHU's on roof installation - units on top


1) Not allowed

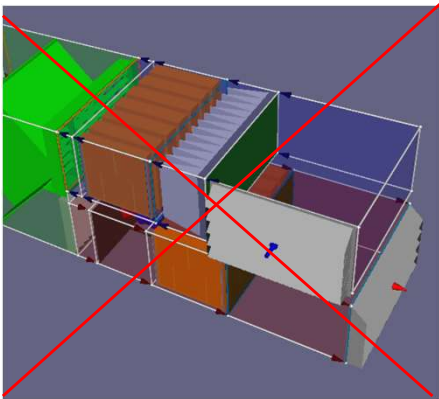

2) Distance A: > 2,0 m

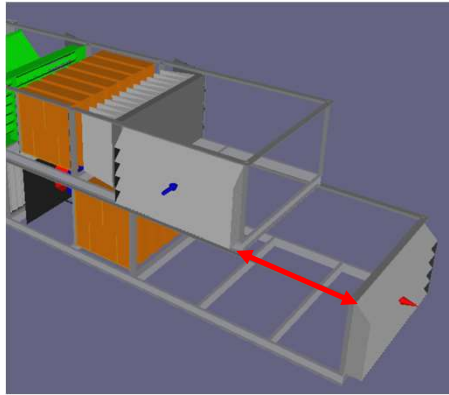


3) Distance A: > 1,3 m

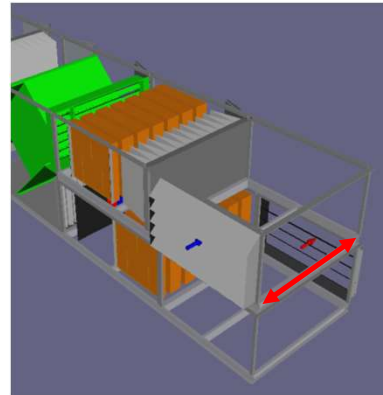


4) Distance A: > 1,3 m

** possible on all three air inlets

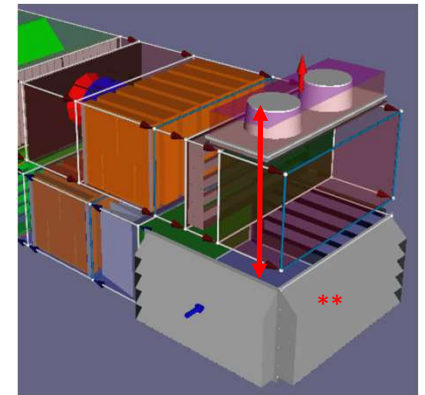


Distance outdoor air / exhaust air for AHU's on roof installation - units side by side


5) Distance A: > 1,3 m

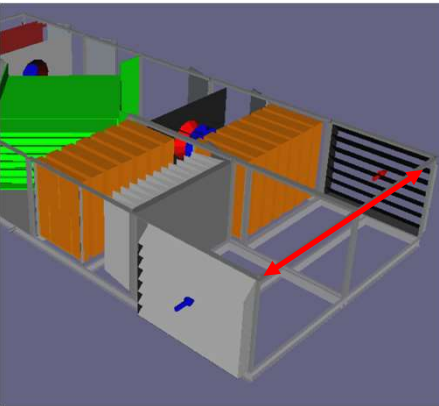

6) Distance A: > 2,0 m

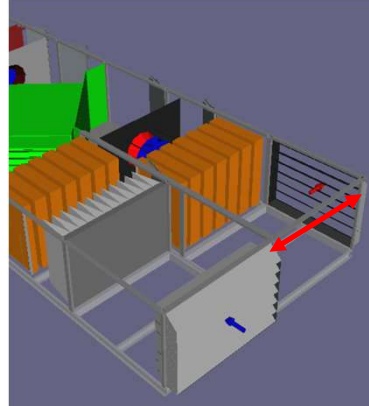

7) Distance A: > 2,0 m

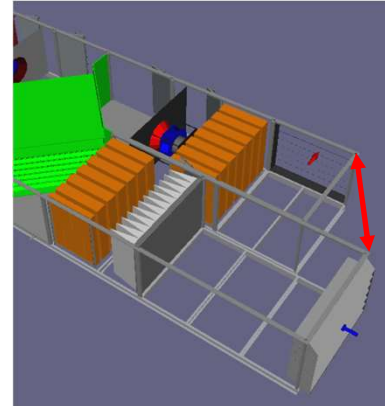

In No. 2;3;5;6 and 7 air inlet and air outlet can be interchanged

by Martin Törpe
Association of Manufacturers of Air
Handling Units
toerpe@rlt-geraete.de